


UNIT TYPE	E-4	H-6	B-2	B-3	S-4	H-5	S-6
ENTERING WATER TEMPERATURE	140°F	140°F	140°F	140°F	140°F	140°F	140°F
MINIMUM CFM HEATING	1.0	1.0	1.0	1.0	1.0	1.0	1.0
HEATING CFM	600	600	600	600	600	600	600
MINIMUM HEATING BTU'S AT CFM	17,000	17,000	17,000	17,000	17,000	17,000	17,000
MODEL NO.	HFC-600	HFC-600	HFC-600	HFC-600	HFC-600	HFC-600	HFC-600
ZONE OF HEATING COILS	2	2	2	2	2	2	2



COILS TO BE MINIMUM TYPE "M" COPPER TUBING

MANUFACTURER - ADAMS FINNAGE CO.  
 129 30 RANCHO AVE.  
 SAN BERNARDINO, CA  
 PH. (714) 824-2013  
 SALES REPRESENTATIVE - ORANGE COUNTY  
 PH. (714) 752-0191

FAN COIL INSTALLATION DETAIL

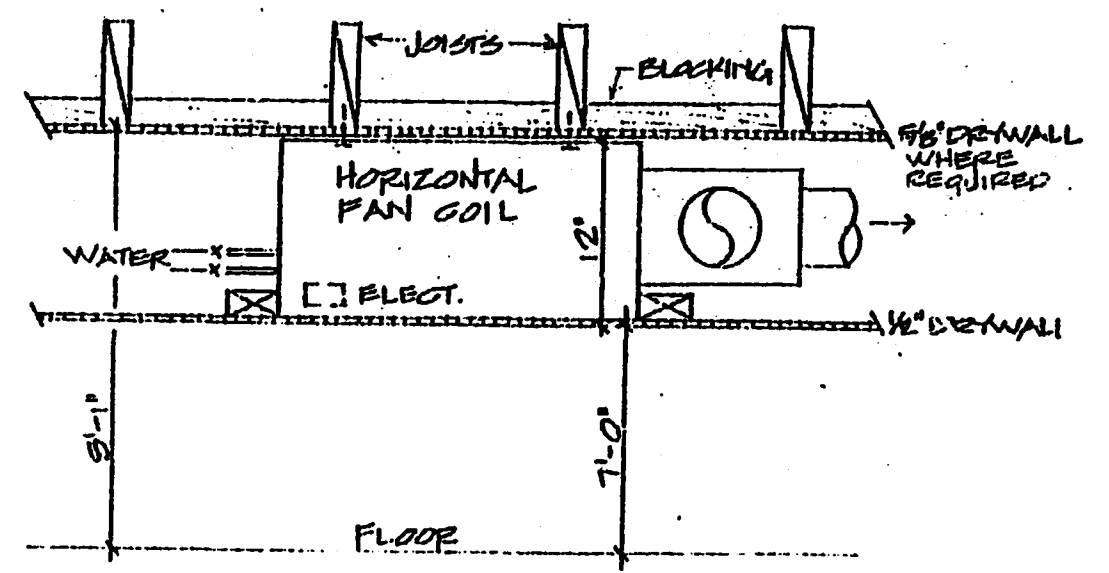

FAN COIL PIPING DETAILS

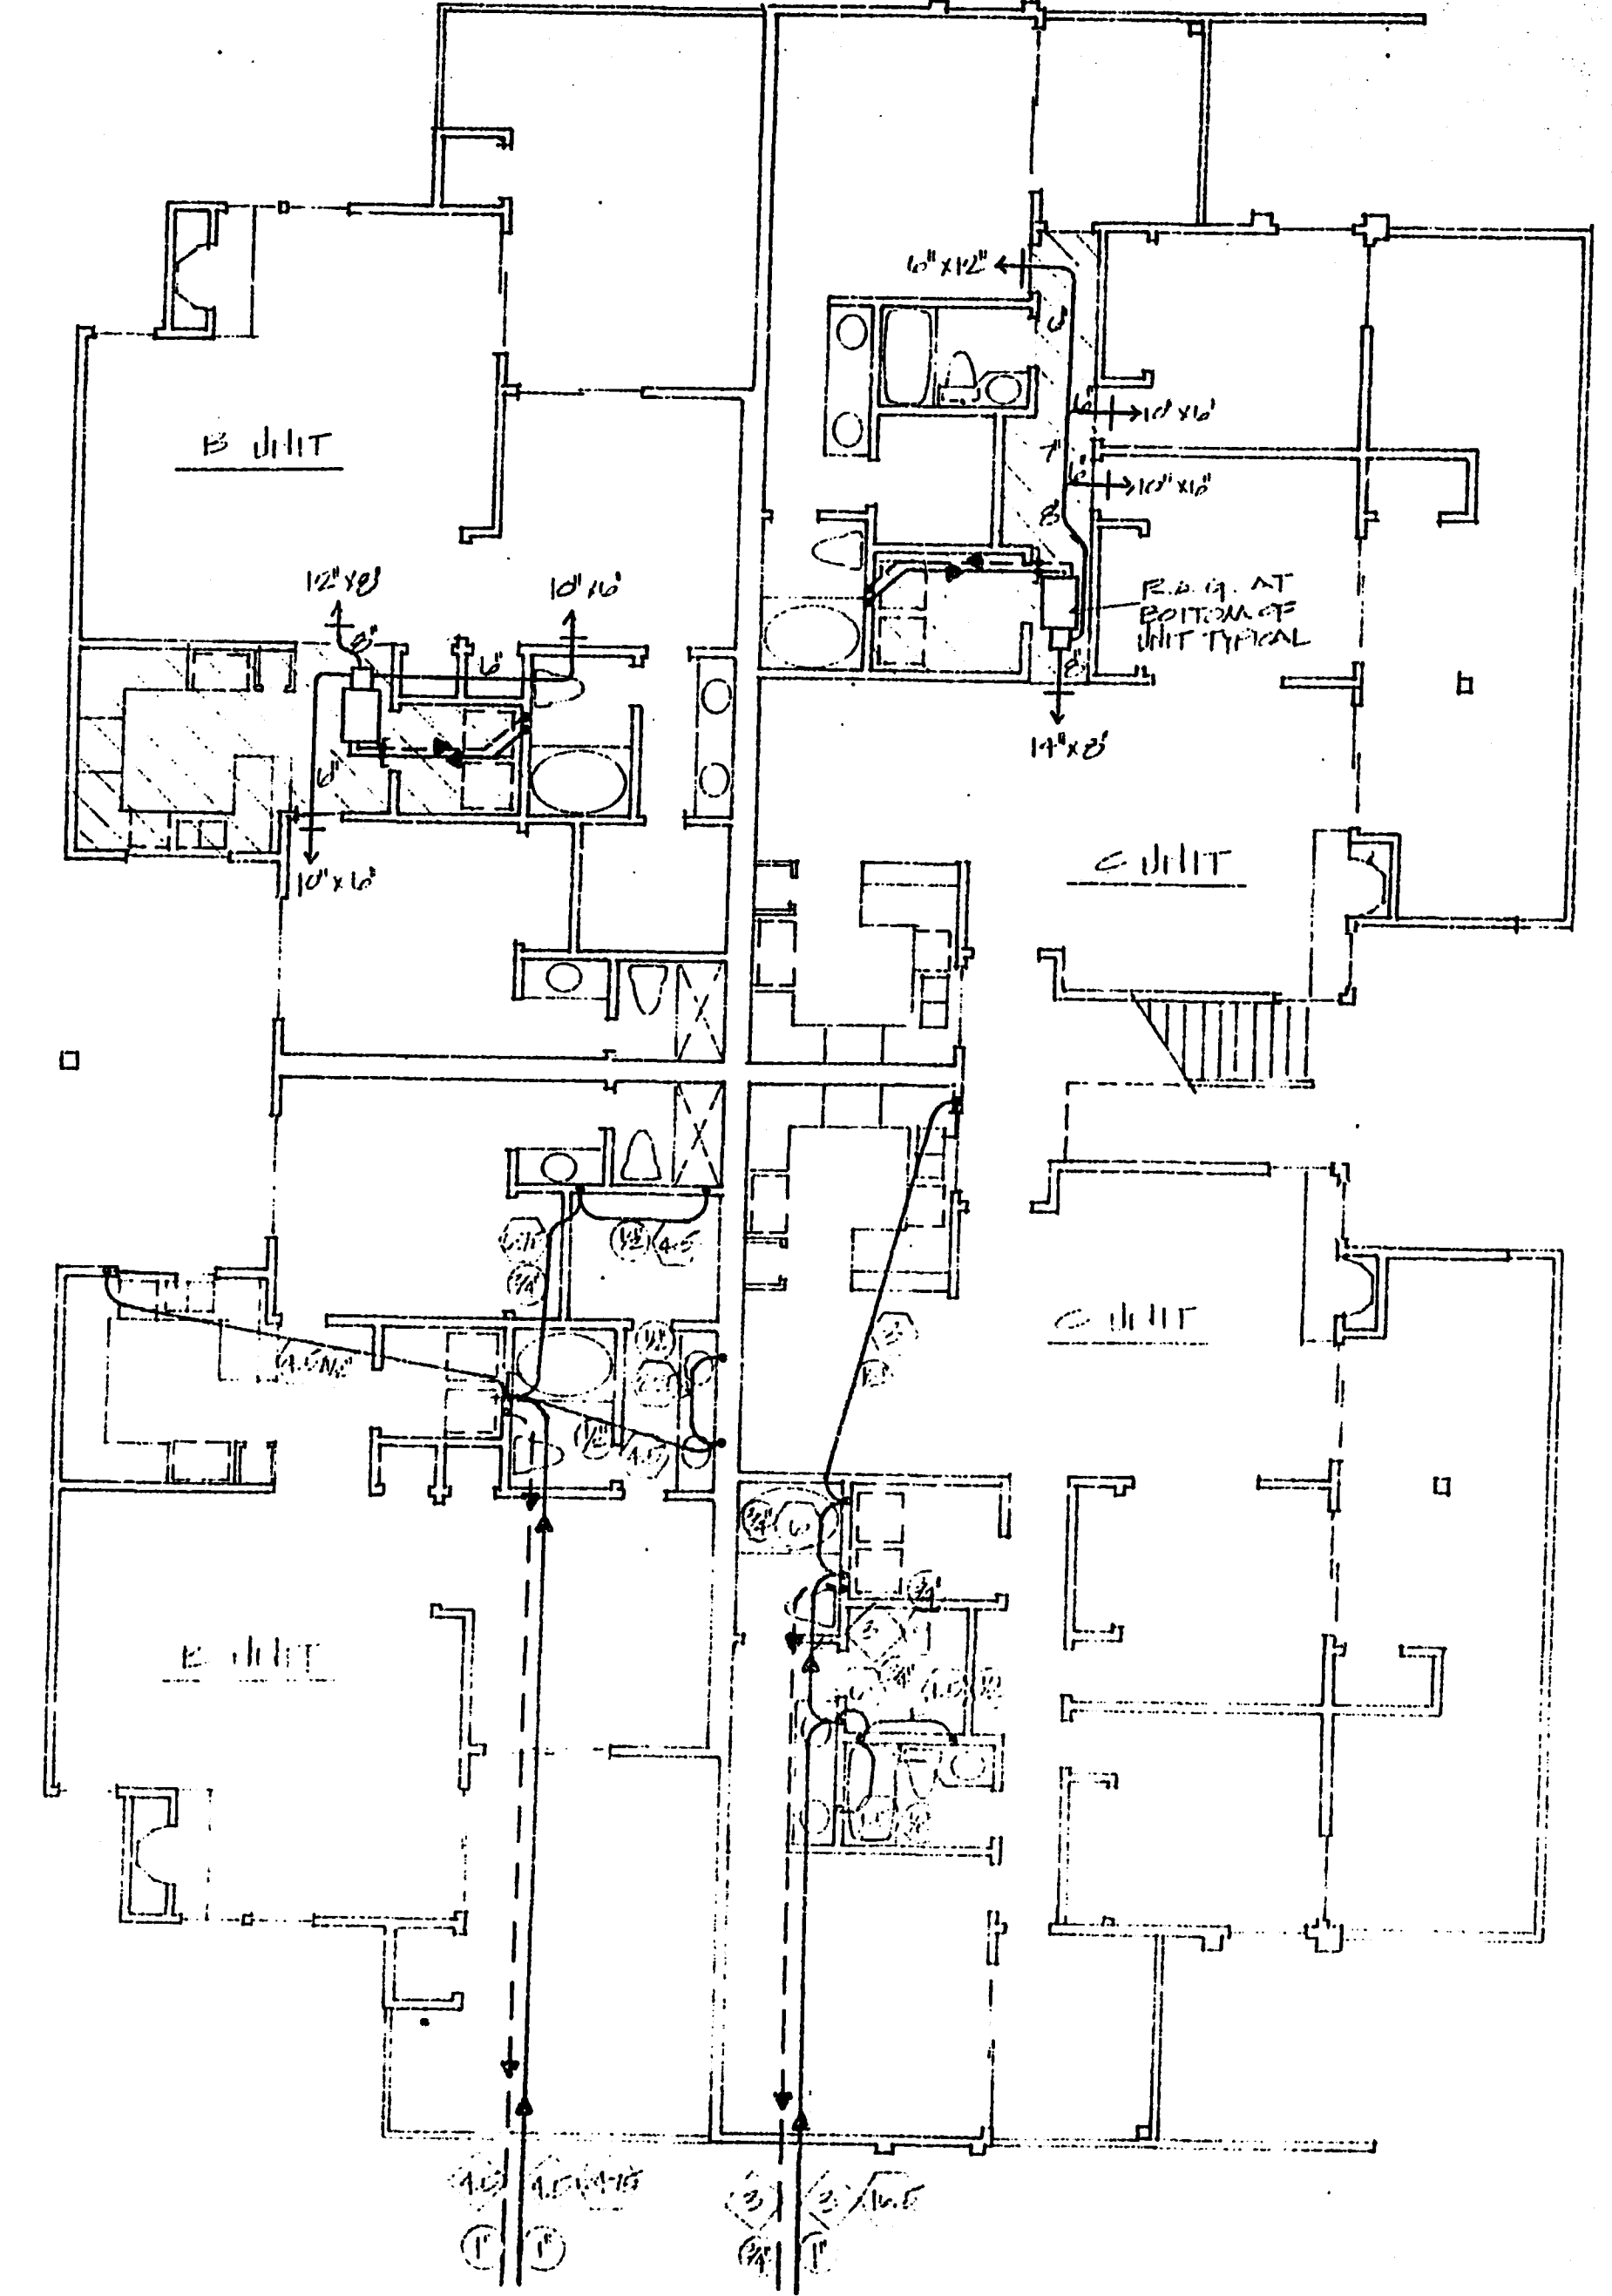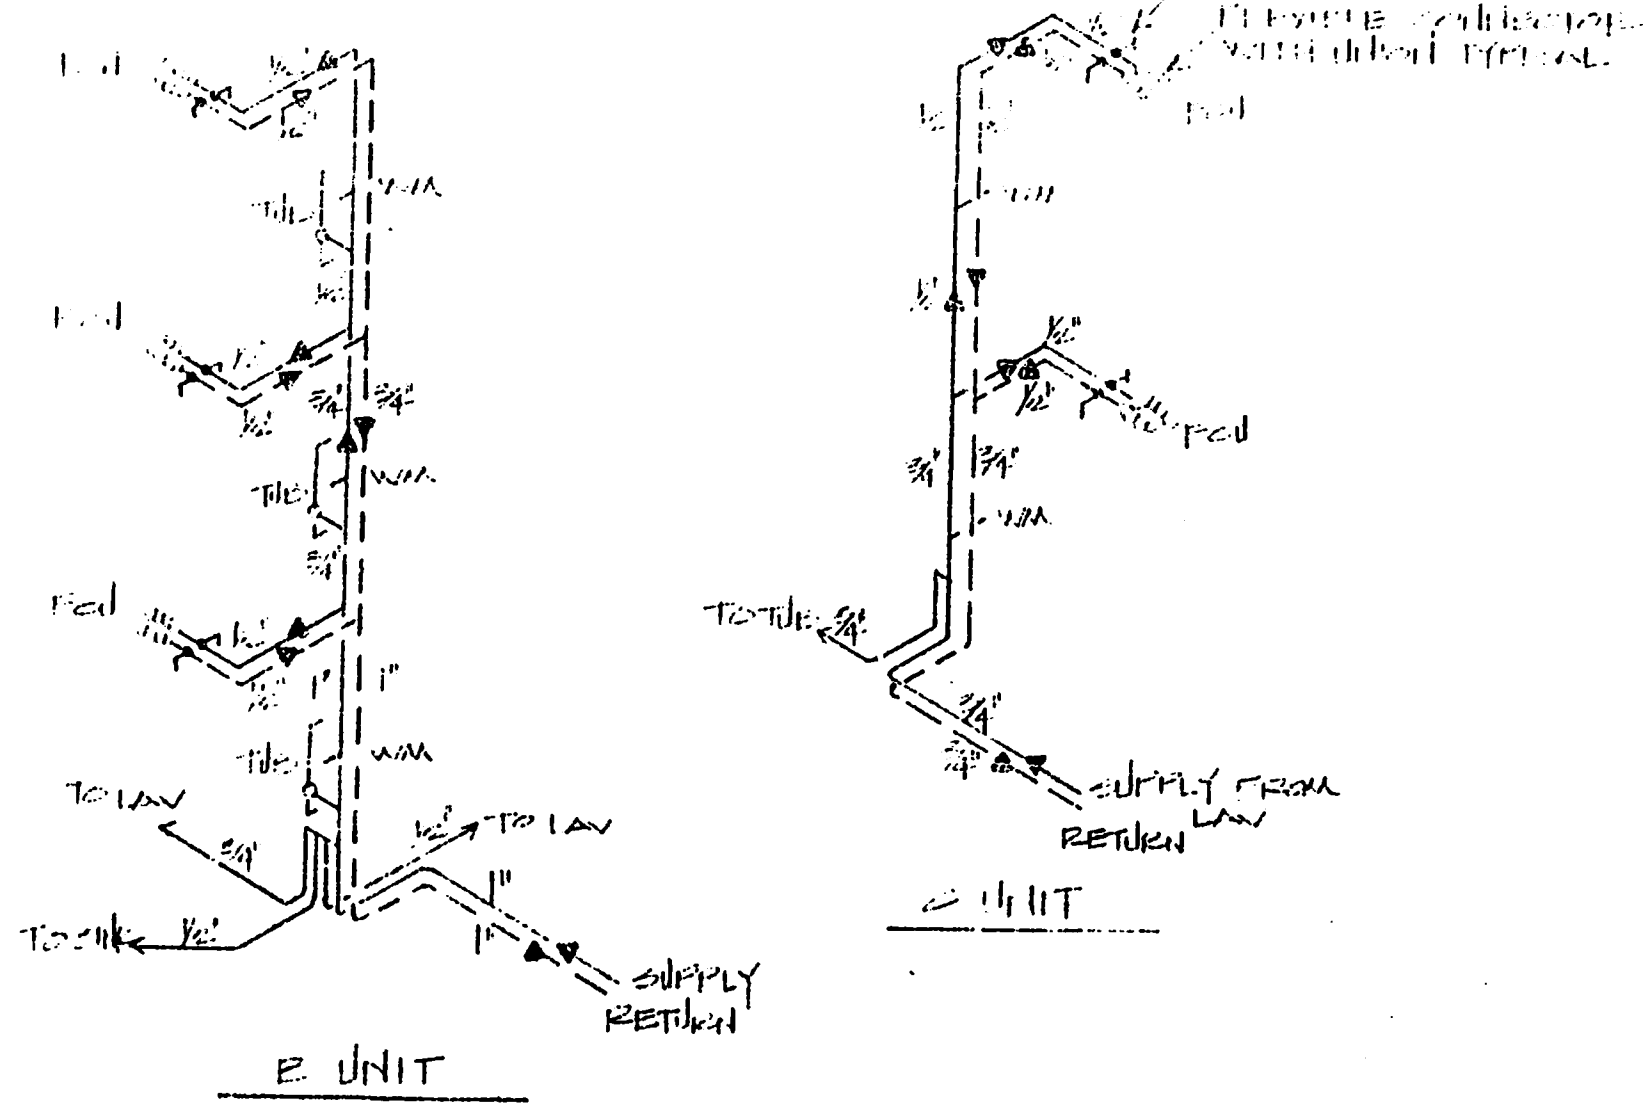


10498

REVISIONS

NO.	DESCRIPTION

PLUMBING DESIGN, INC.  
 2550 PERATA DR. SUITE B  
 LAGUNA HILLS, CA. 92653  
 (714) 770-4000



WOOLSEY & HERMANSEN  
 15553 SHENANDOALE SITE "A"  
 HUNTINGTON BEACH, CA. 92649  
 (714) 891-8501

HARBOR VISTA  
 PHASE TWO  
 100 UNIT CONDOMINIUM  
 HUNTINGTON BEACH, CA.

DESIGNED BY  
 CATHY  
 JOB NO.  
 10-110-EX  
 DATE  
 A04  
 SHEET

RAYDRONIC

P-2  
 OF 2